

"Replacement Sheet"

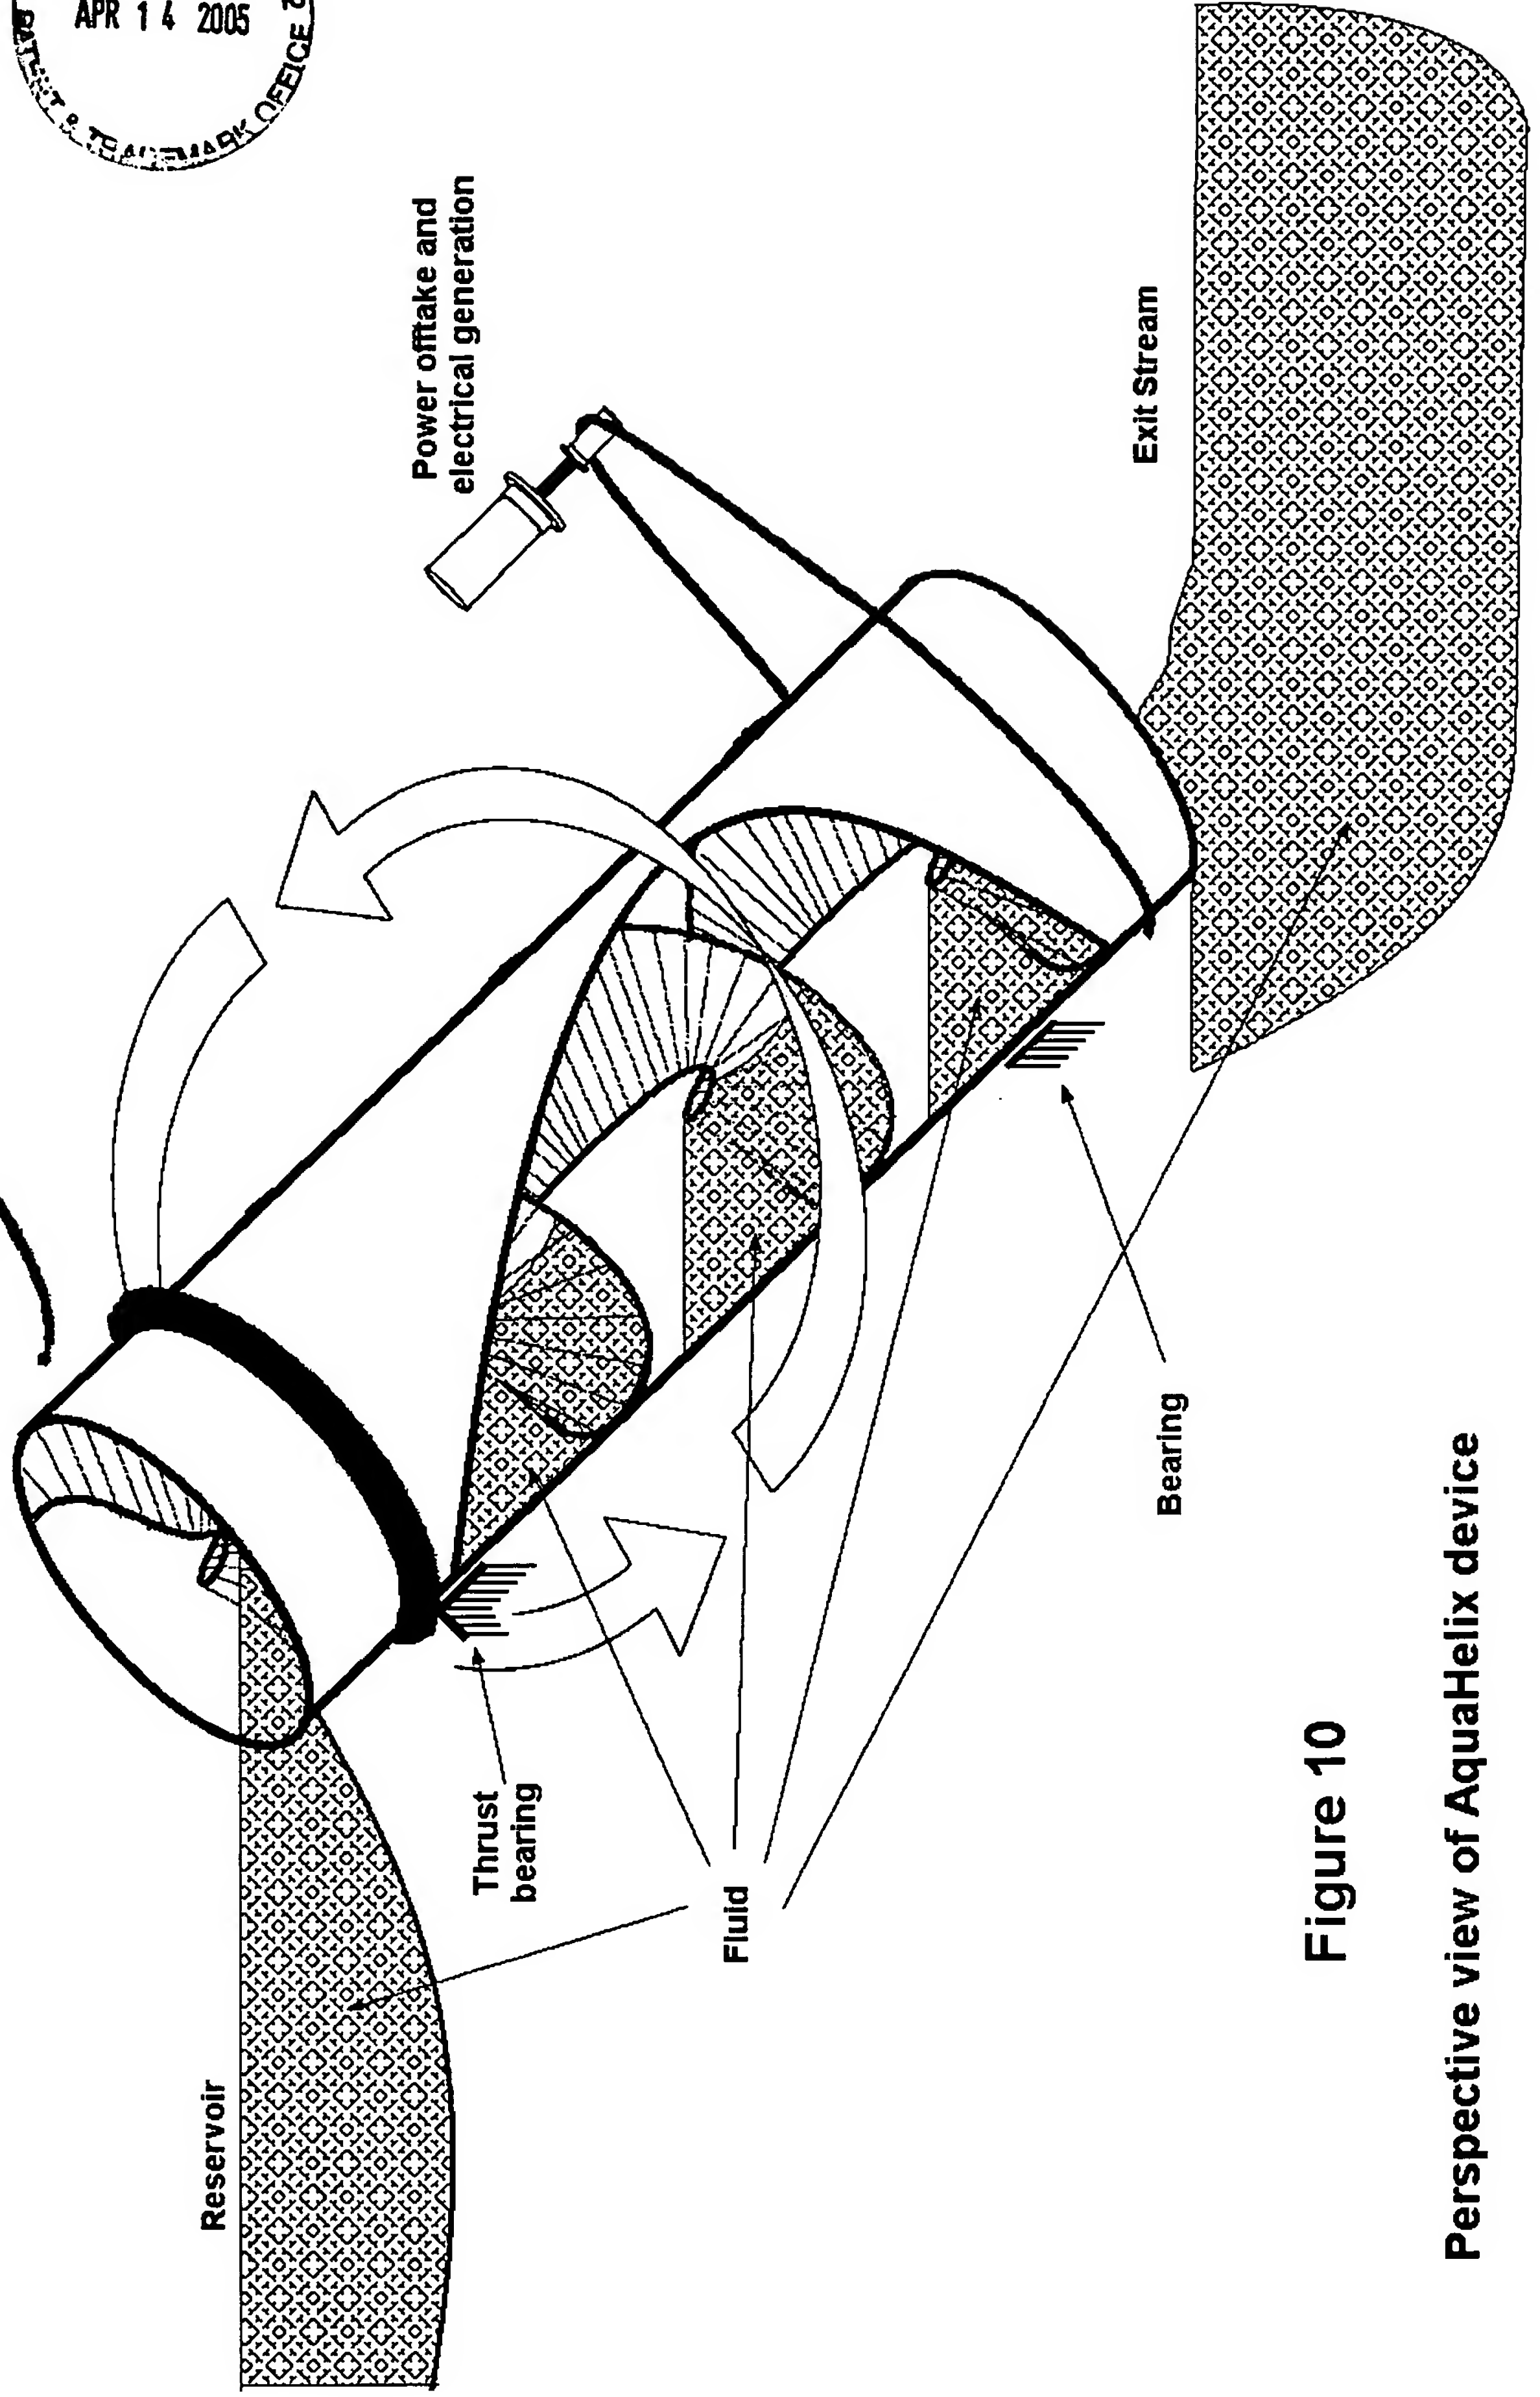


Figure 10

Perspective view of AquaHelix device

"Replacement Sheet"

Sections of the housing and baffle can be added or removed to change the length of the device and thereby adjust the entrance elevation as needed based on the level of the supply reservoir.

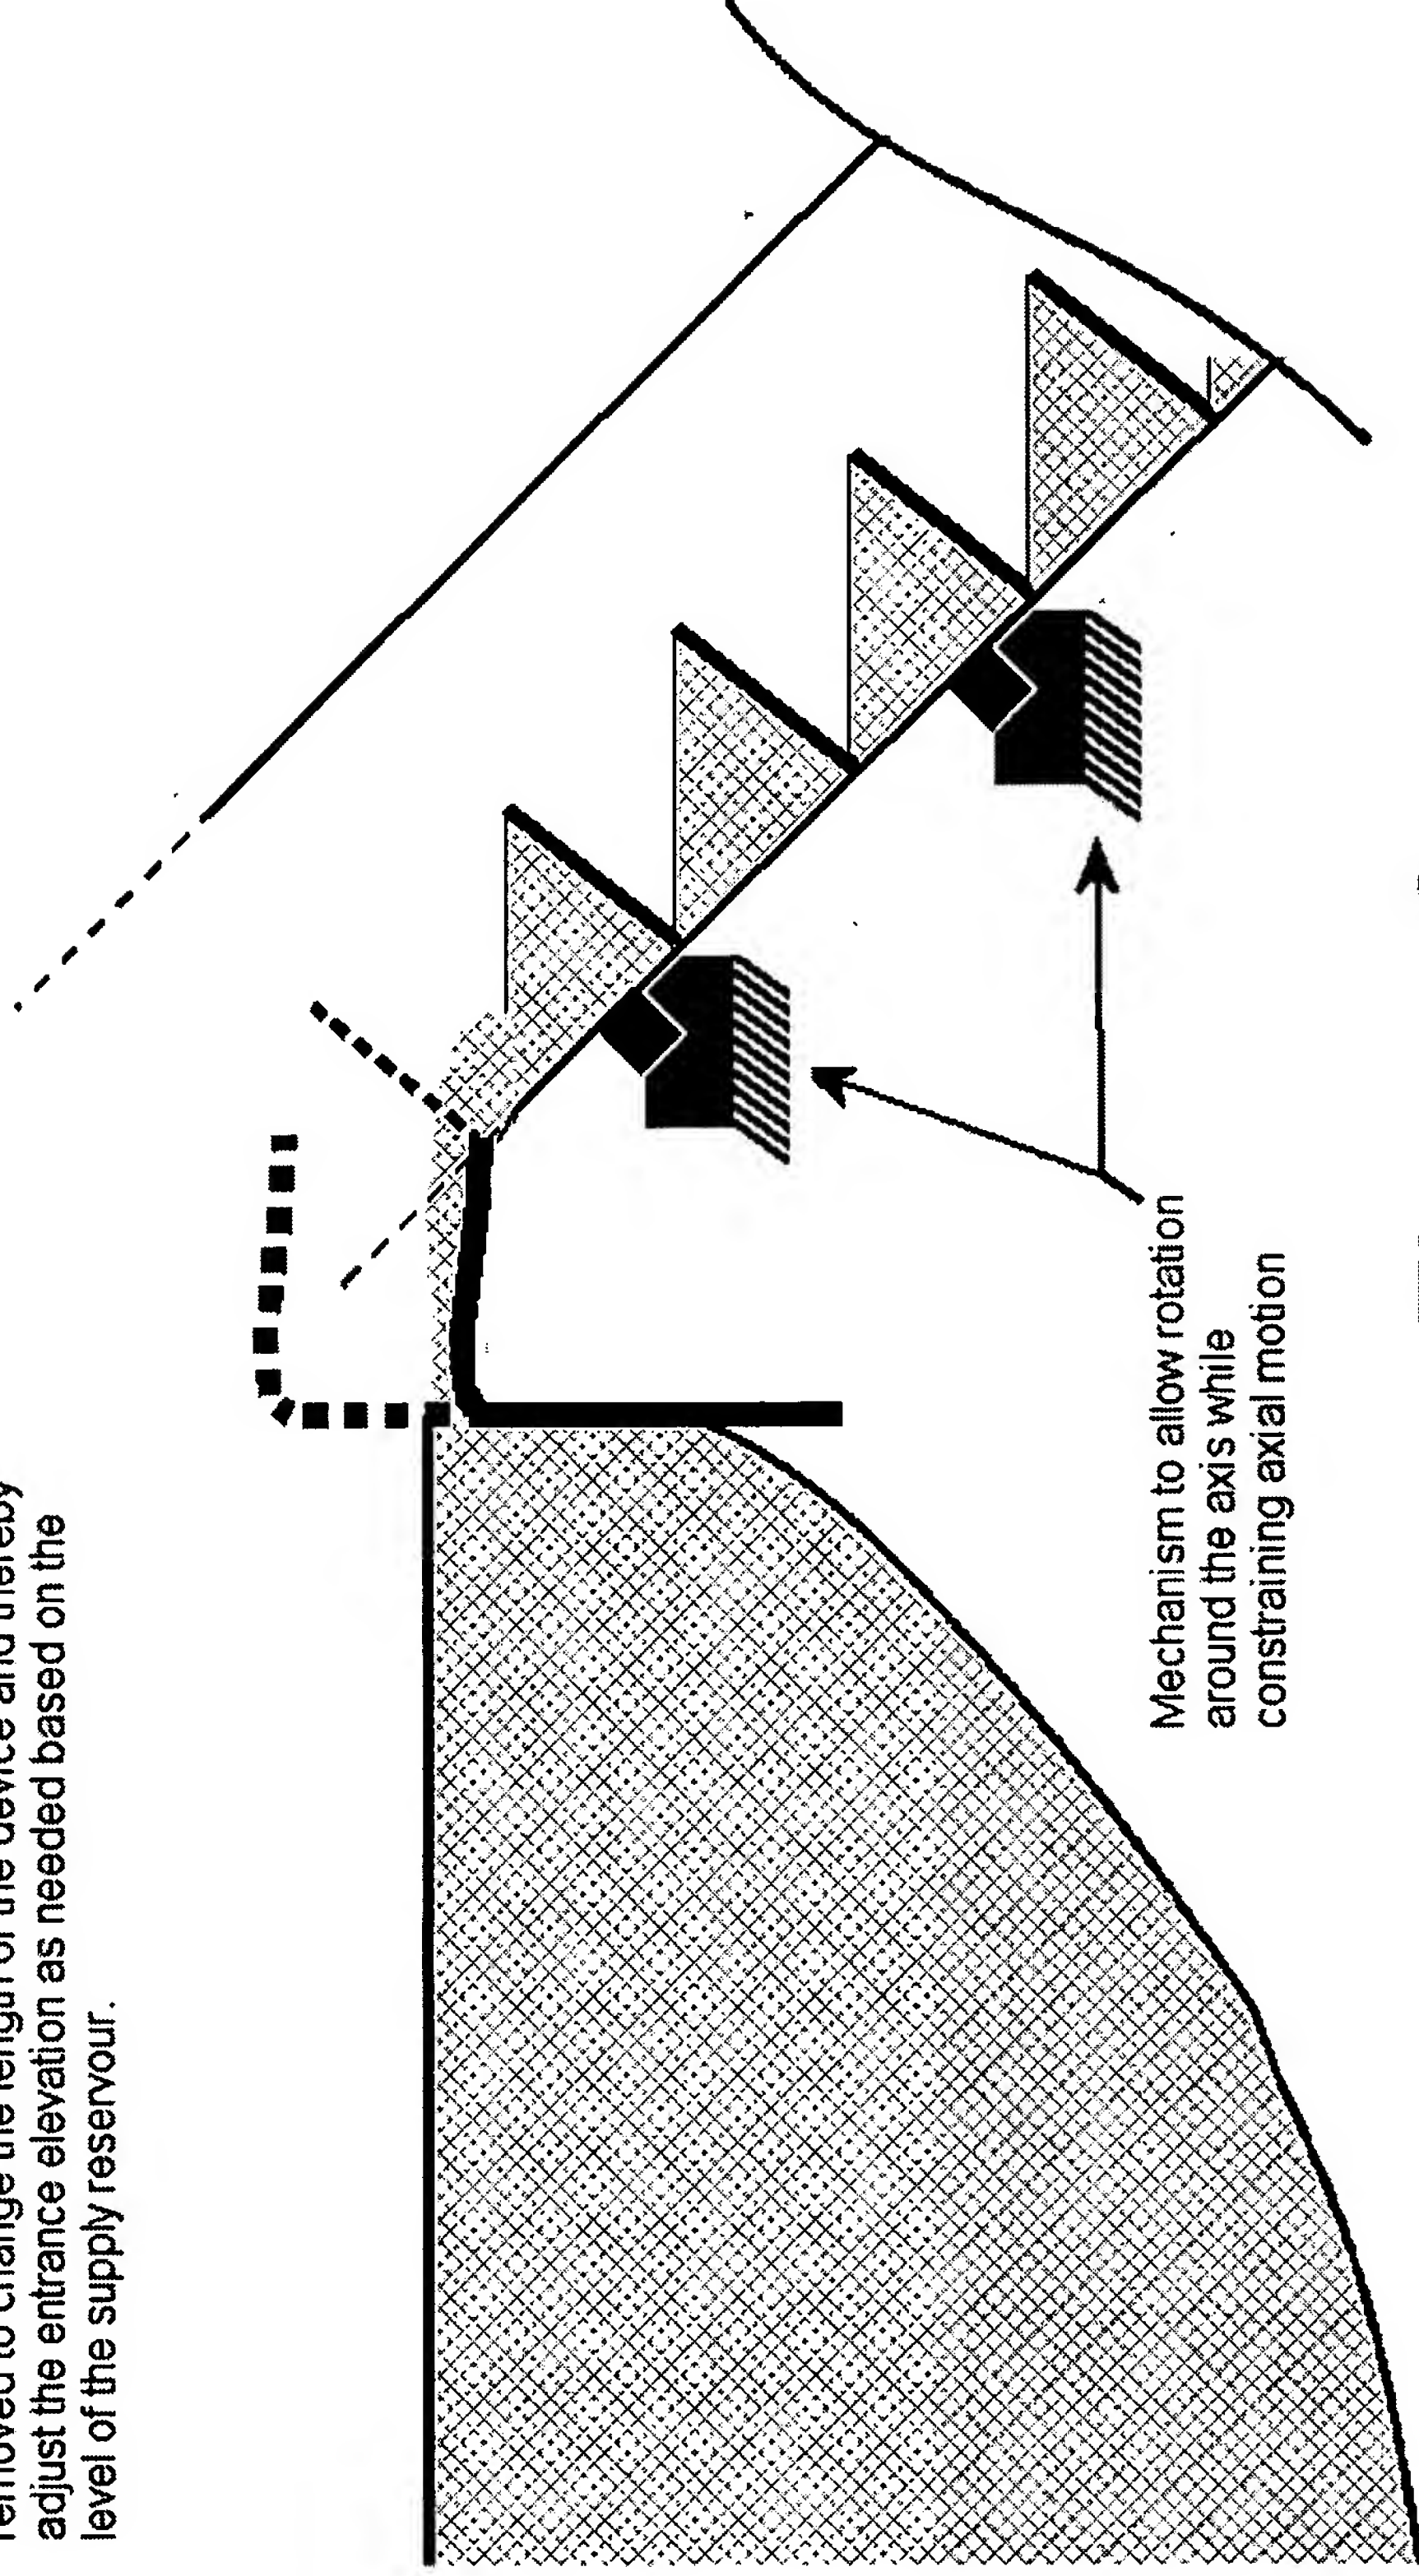


Figure 8

Change in input elevation via shortening
or lengthening of the device